


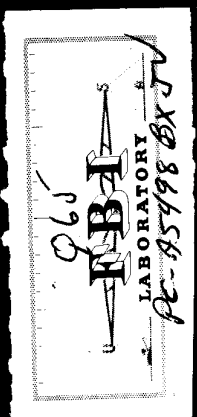
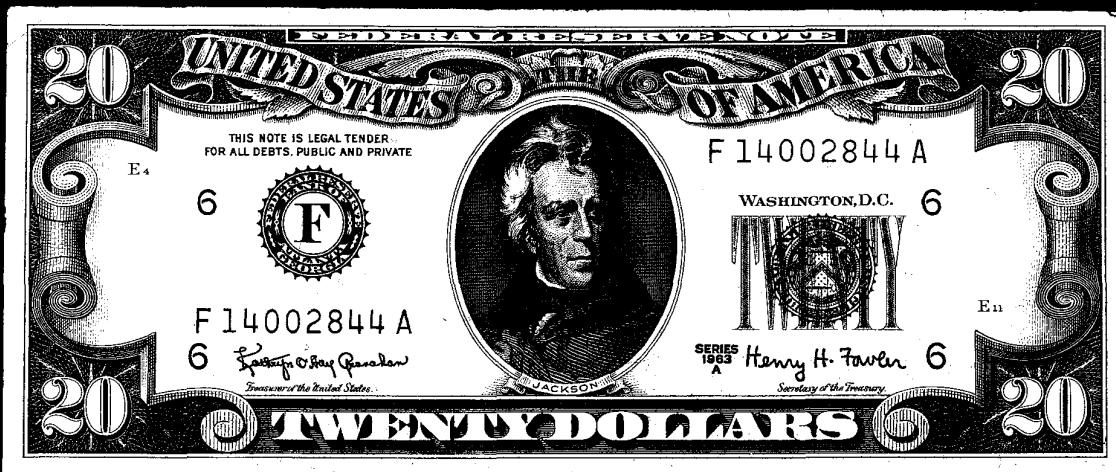
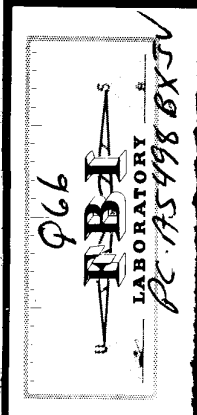


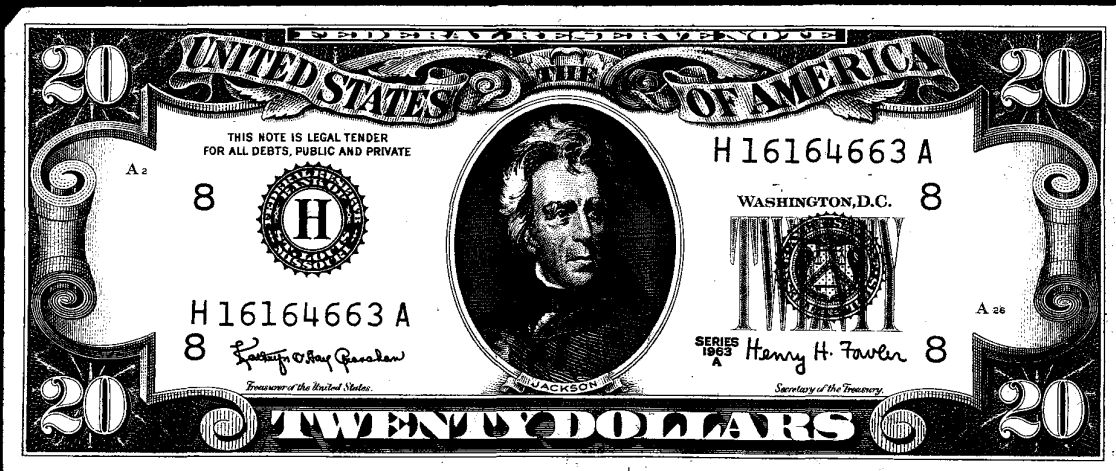


FBI
LABORATORY

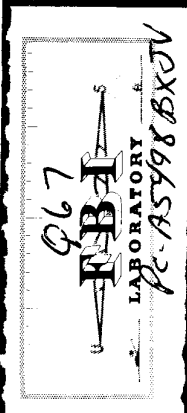


FBI
LABORATORY

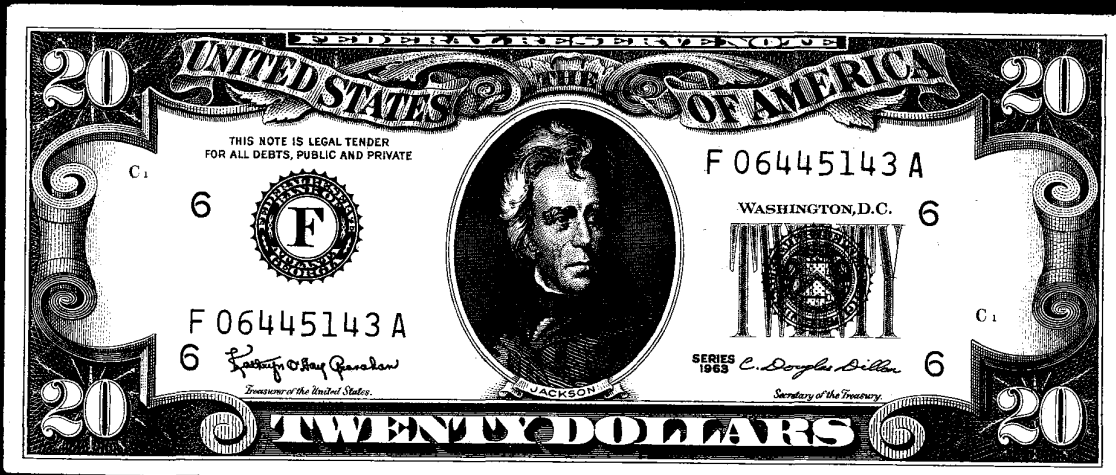


965
FBI
LABORATORY
PC-A5498 BX JV

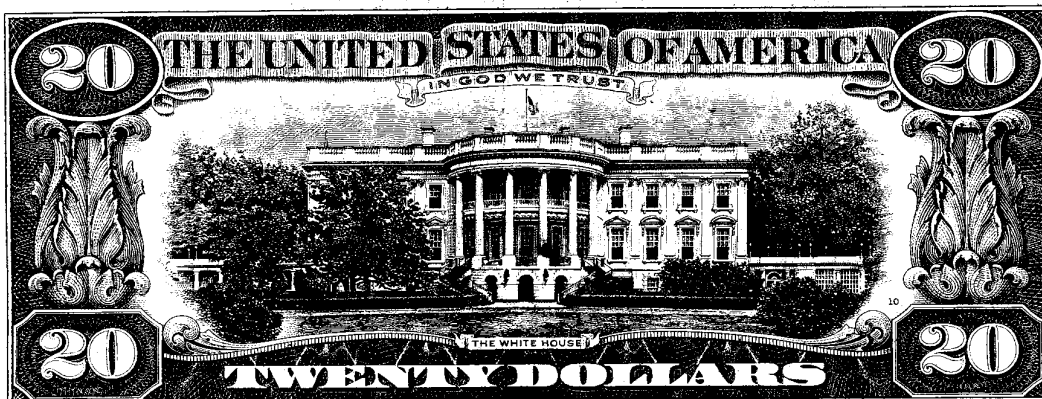

966
FBI
LABORATORY
PC-A5498 BX JV

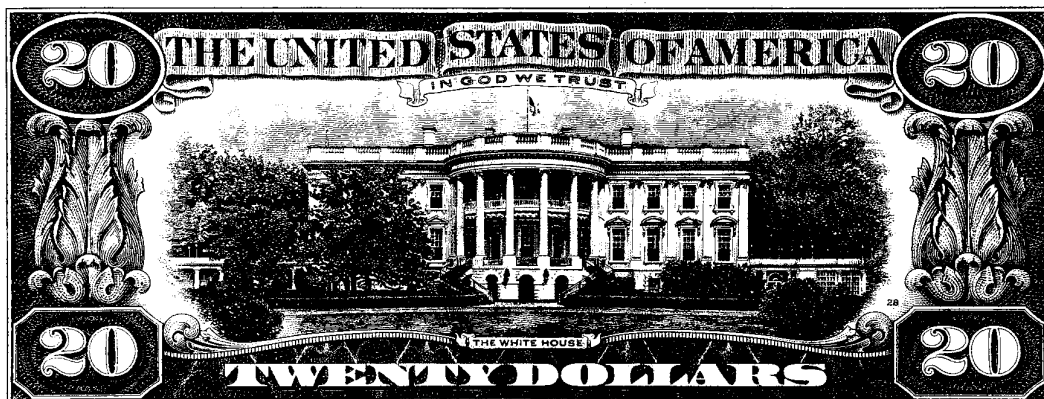

967
FBI
LABORATORY
PC-A5498 BX JV

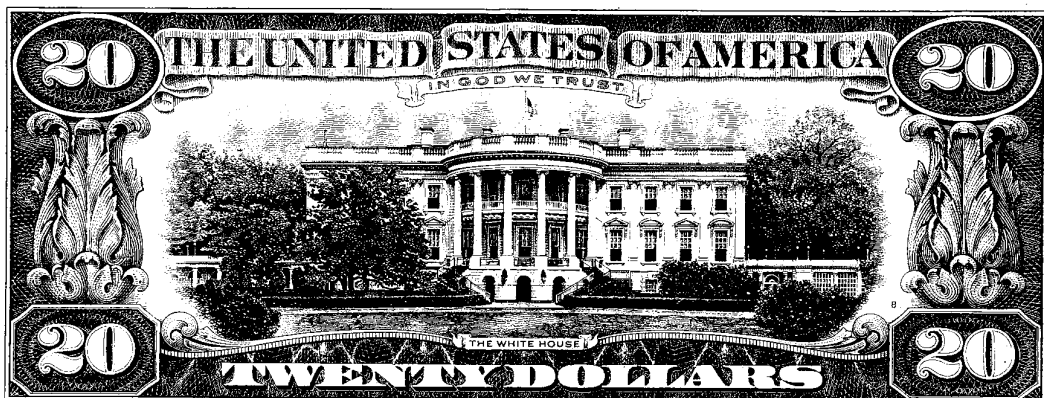

APPLICANT

LEAVE THIS SPACE BLANK

LAST NAME

FIRST NAME

MIDDLE NAME

SEX

RACE

BREWER

BESSIE

RUTH

FEM.

CAUC.

HT. (Inches)

WT.

5' 1/2"

120

HAIR

EYES

BROWN

DATE OF BIRTH

SIGNATURE OF PERSON FINGERPRINTED

Bessie Ruth Brewer

RESIDENCE OF PERSON FINGERPRINTED

420 1/2 S. Main

SIGNATURE OF OFFICIAL TAKING FINGERPRINTS

L. L. Lusk

TYPE OR PRINT ALL REQUESTED DATA

CONTRIBUTOR AND ADDRESS

CHIEF
POLICE DEPARTMENT
MEMPHIS, TENN. 38103

COMPANY AND ADDRESS

NUMBER

DATE FINGERPRINTED

4/18/68

PLACE OF BIRTH

CITIZENSHIP

LEAVE THIS SPACE BLANK

CLASS.

REF.

See reverse side for further instructions

1. RIGHT THUMB



2. RIGHT INDEX



3. RIGHT MIDDLE



4. RIGHT RING



5. RIGHT LITTLE



6. LEFT THUMB



7. LEFT INDEX



8. LEFT MIDDLE




9. LEFT RING



10. LEFT LITTLE



LEFT FOUR FINGERS TAKEN SIMULTANEOUSLY

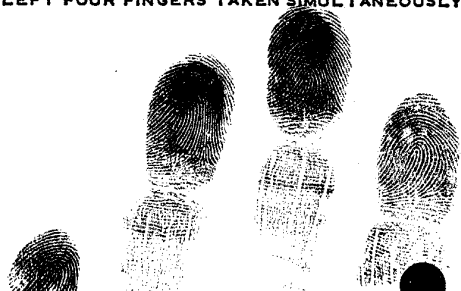


LEFT THUMB



RIGHT THUMB



RIGHT FOUR FINGERS TAKEN SIMULTANEOUSLY

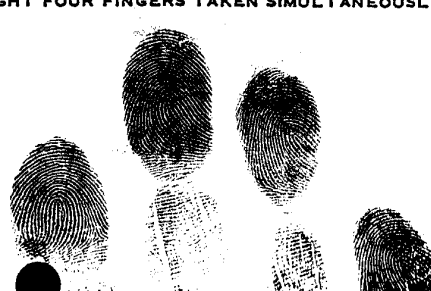


**FEDERAL BUREAU OF INVESTIGATION
UNITED STATES DEPARTMENT OF JUSTICE
WASHINGTON, D.C. 20537**

APPLICANT

To obtain classifiable fingerprints:


1. Use printer's ink.
2. Distribute ink evenly on inking slab.
3. Wash and dry fingers thoroughly.
4. Roll fingers from nail to nail, and avoid allowing fingers to slip.
5. Be sure impressions are recorded in correct order.
6. If an amputation or deformity makes it impossible to print a finger, make a notation to that effect in the individual finger block.
7. If some physical condition makes it impossible to obtain perfect impressions, submit the best that can be obtained with a memo stapled to the card explaining the circumstances.
8. Examine the completed prints to see if they can be classified, bearing in mind the following:
Most fingerprints fall into the patterns shown below (other patterns occur infrequently and are not shown here):

1. LOOP

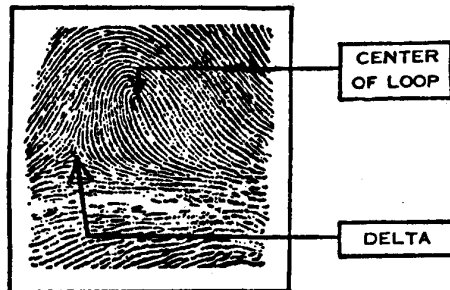

THE LINES BETWEEN CENTER OF LOOP AND DELTA MUST SHOW

2. WHORL

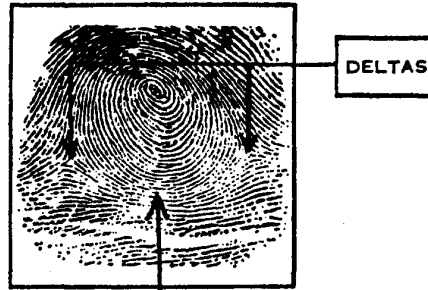

THESE LINES RUNNING BETWEEN DELTAS MUST BE CLEAR

3. ARCH



ARCHES HAVE NO DELTAS

Law-enforcement agencies using this card for pistol permits, licenses, etc., should indicate type of permit or position in space "COMPANY AND ADDRESS."

Department of Defense activities and contractors initiating this card will make no entries in "CONTRIBUTOR AND ADDRESS" and "NUMBER." Such entries will be made by the Department of Defense investigative agencies concerned. Department of Defense activities using this card for military personnel or civilian employees will enter designation and address of requesting activity in "COMPANY AND ADDRESS." Department of Defense contractors will enter contractor's name and address in "COMPANY AND ADDRESS."

The space "NUMBER" should contain the number designated for the particular case or code designation. The number appearing in this space will be quoted on answers to the fingerprint search.

44-38861-5920



2025 RELEASE UNDER E.O. 14176

Q64



2025 RELEASE UNDER E.O. 14176

BROWNING


SHOTGUNS RIFLES PISTOLS



Mauser Rifle

BROWNING



Q57
— FBI —
LABORATORY
PC A5476 11x JV

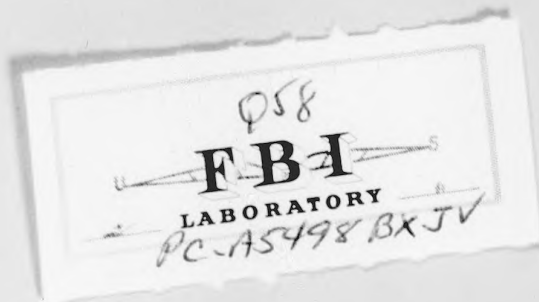

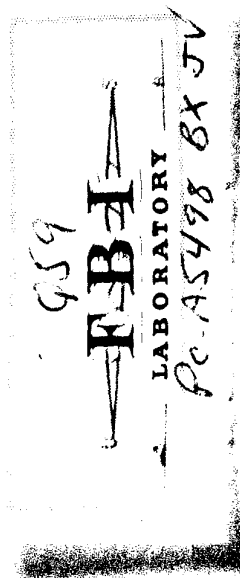

YORK ARMS CO.

"If it's Sporting Goods, we have it"


3 Convenient Locations

Downtown - 162 So. Main 526-1217


East - - - Poplar Plaza 452-1173

South - - - Whitehaven Plaza 397-4497

MEMPHIS



025

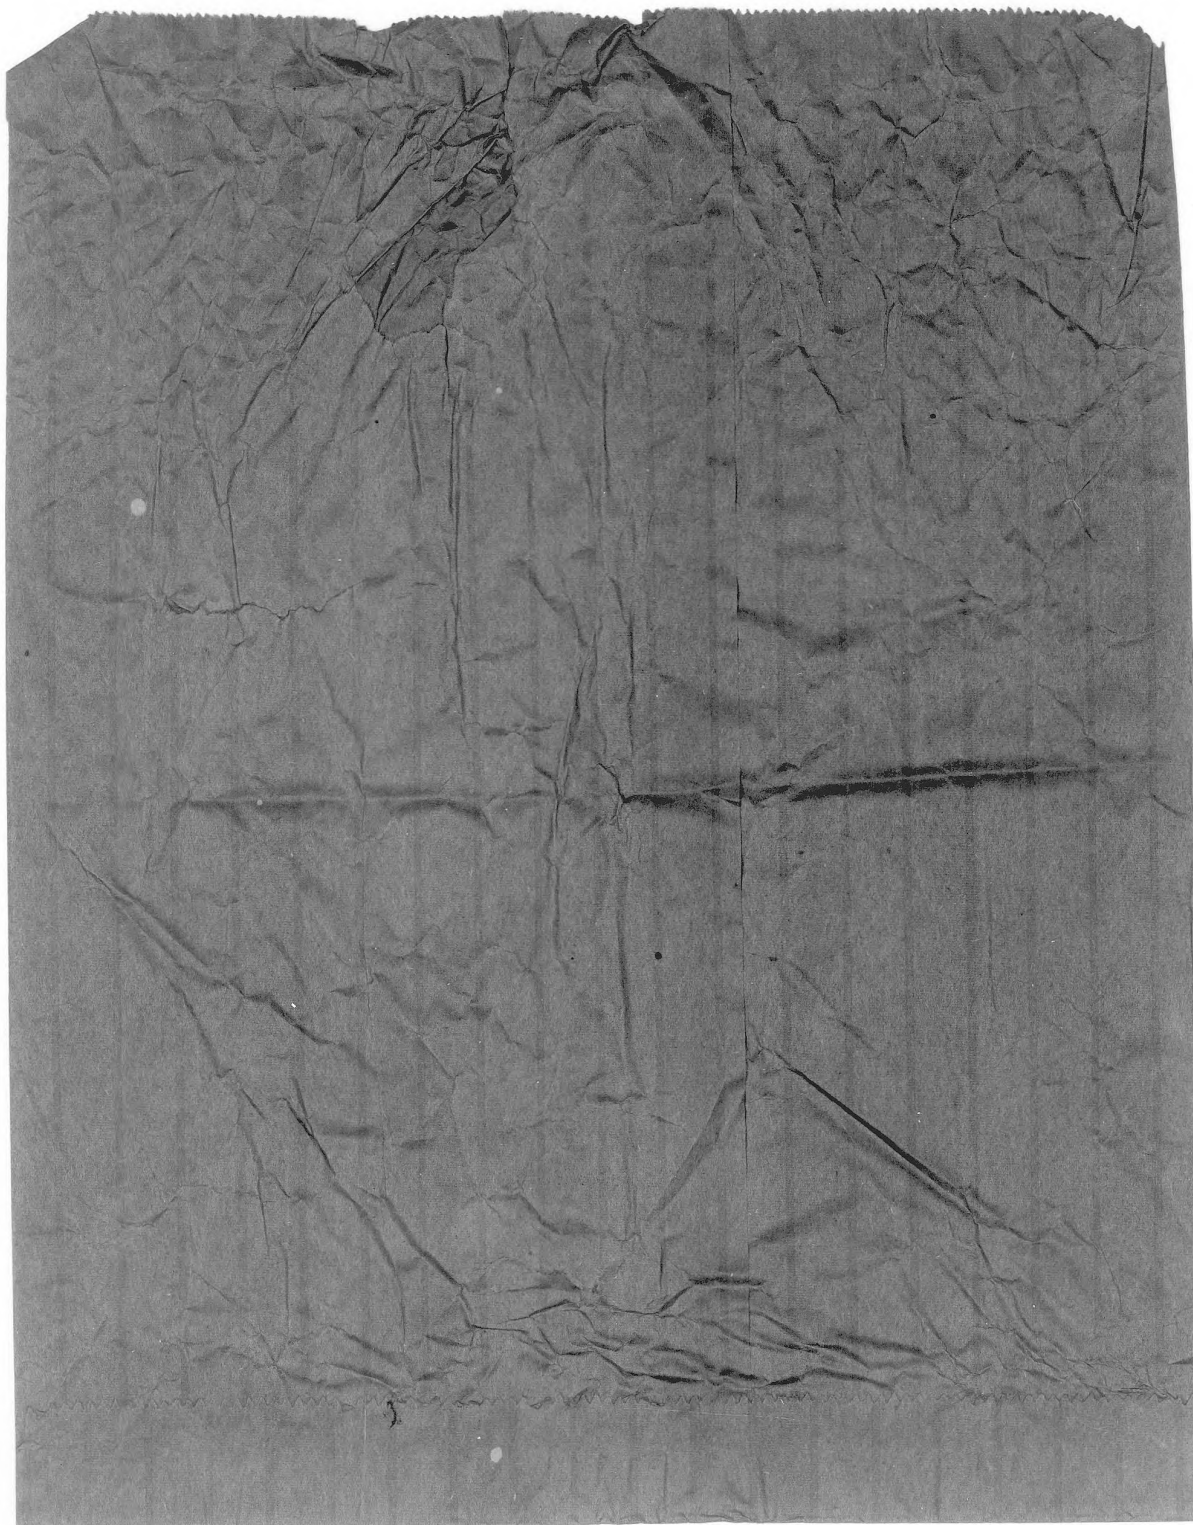


PC A5498 BX JV
— FBI —
— LABORATORY —

Q25



FBI
FEDERAL BUREAU OF INVESTIGATION
WASHINGTON, D. C.

Q16
FBI
LABORATORY
PC-A5498 EX JV





EVI
FEDERAL BUREAU OF INVESTIGATION
WASHINGTON, D.C. 20535

Q27
FBI
LABORATORY
PC A5998 BX JV

MADE IN U.S.A. - U.S. Pat. 2,689,170 - 2,772,203
The active ingredient Sodium M-Lauroyl Sarcosinate
KALITE PALMOLIVE CO., New York, N.Y. - "Colgate"

DENTAL CREAM
with GARDOL

IMPROVED*
Colgate

Q28
FBI
LABORATORY

Net Wt. 3.50 Oz.
WITH THE POWER THAT

With G
TAL
CIGARETTES

IMPROVED*
Colgate

Q28
FBI
LABORATORY

[illegible]

Going Places?


Before you go ask your Standard Oil Dealer for a FREE trip routing from Standard Oil Touring Service. Ask him, too, for a pre-trip car check to be sure your car is ready for your business or vacation trip!










WHEREVER YOU GO
use a Standard Oil Credit
Card! Good in 50 states
and Canada for gasoline,
oil and other auto needs.

[illegible][illegible]

Illustrated Guide to GEORGIA-ALABAMA

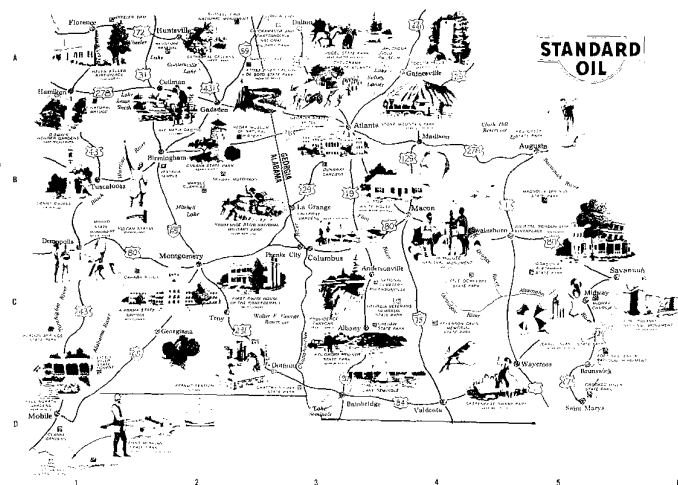


PLACES AND THINGS TO SEE

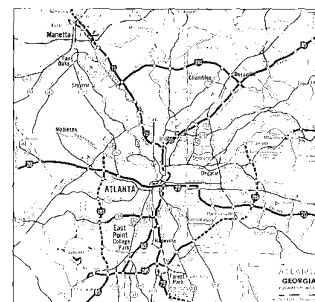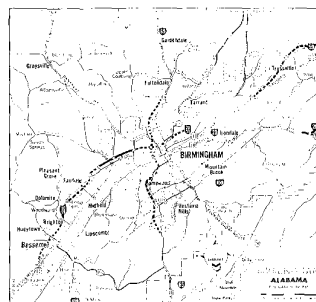
[illegible]

Q18
FBI
LABORATORY

of
FBI
LABORATORY

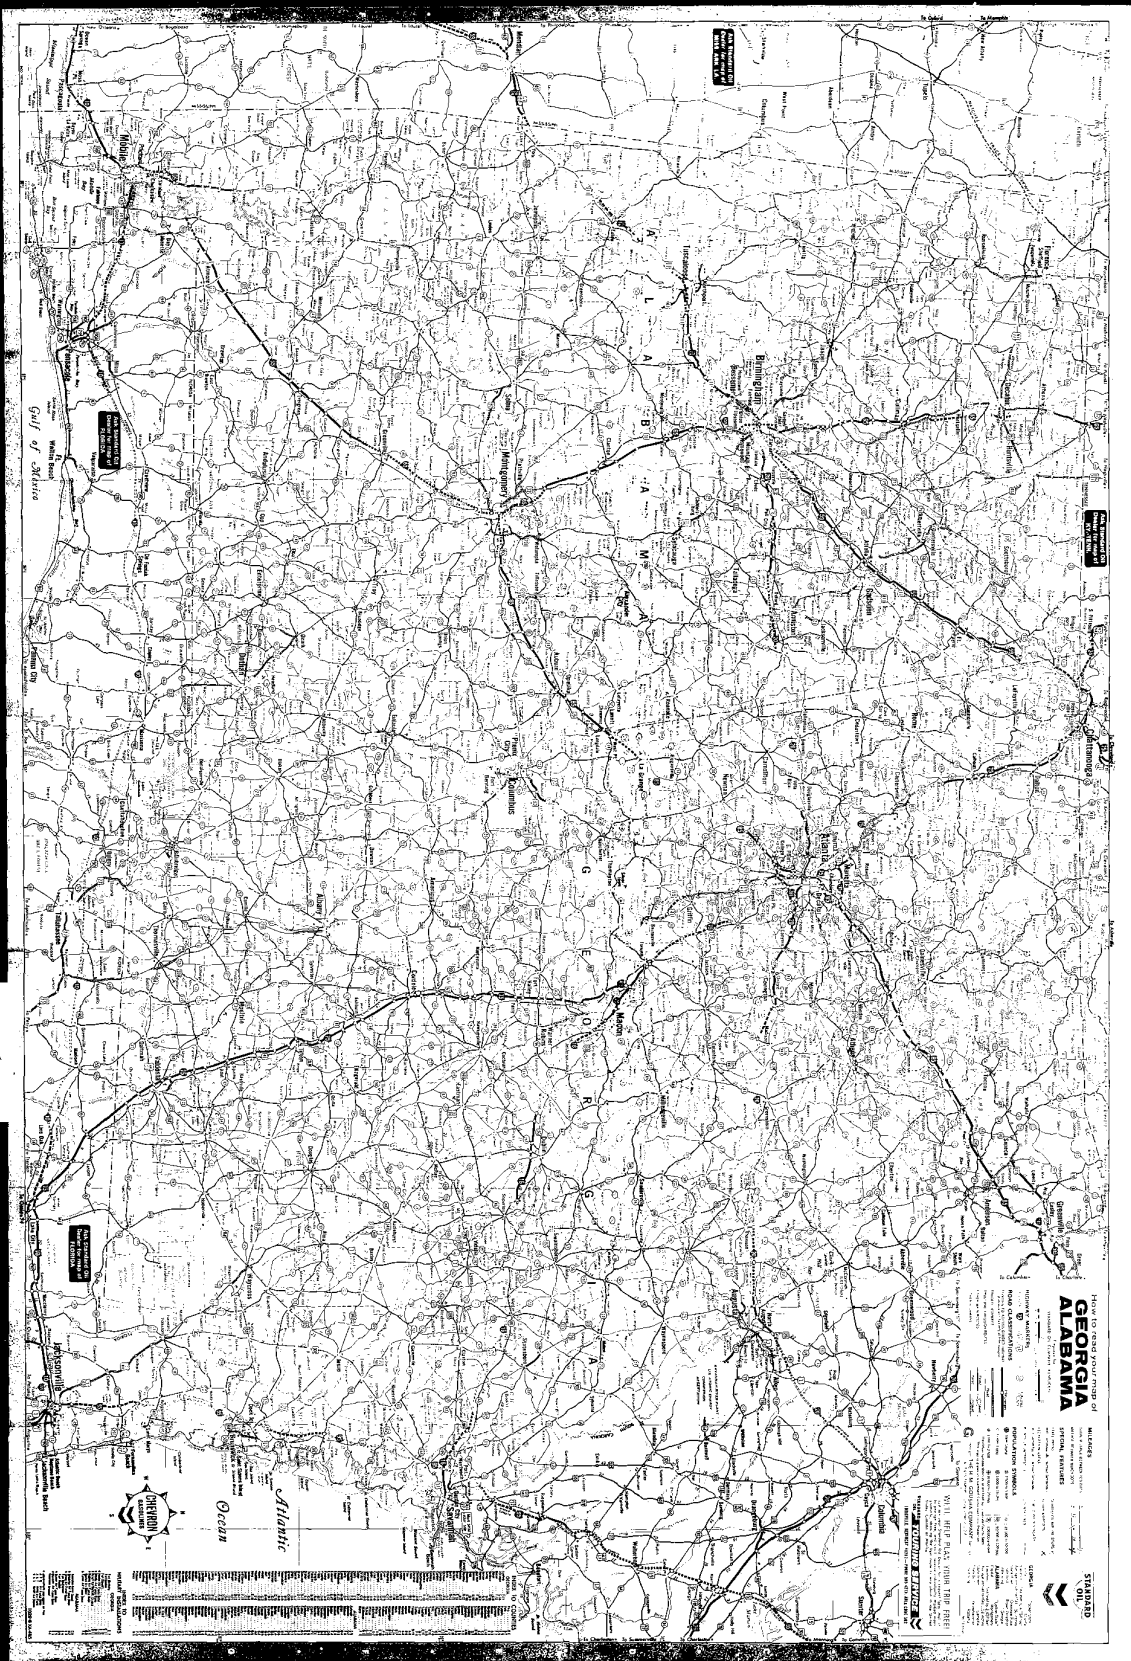

Q2
FBI
JAN 19 1964

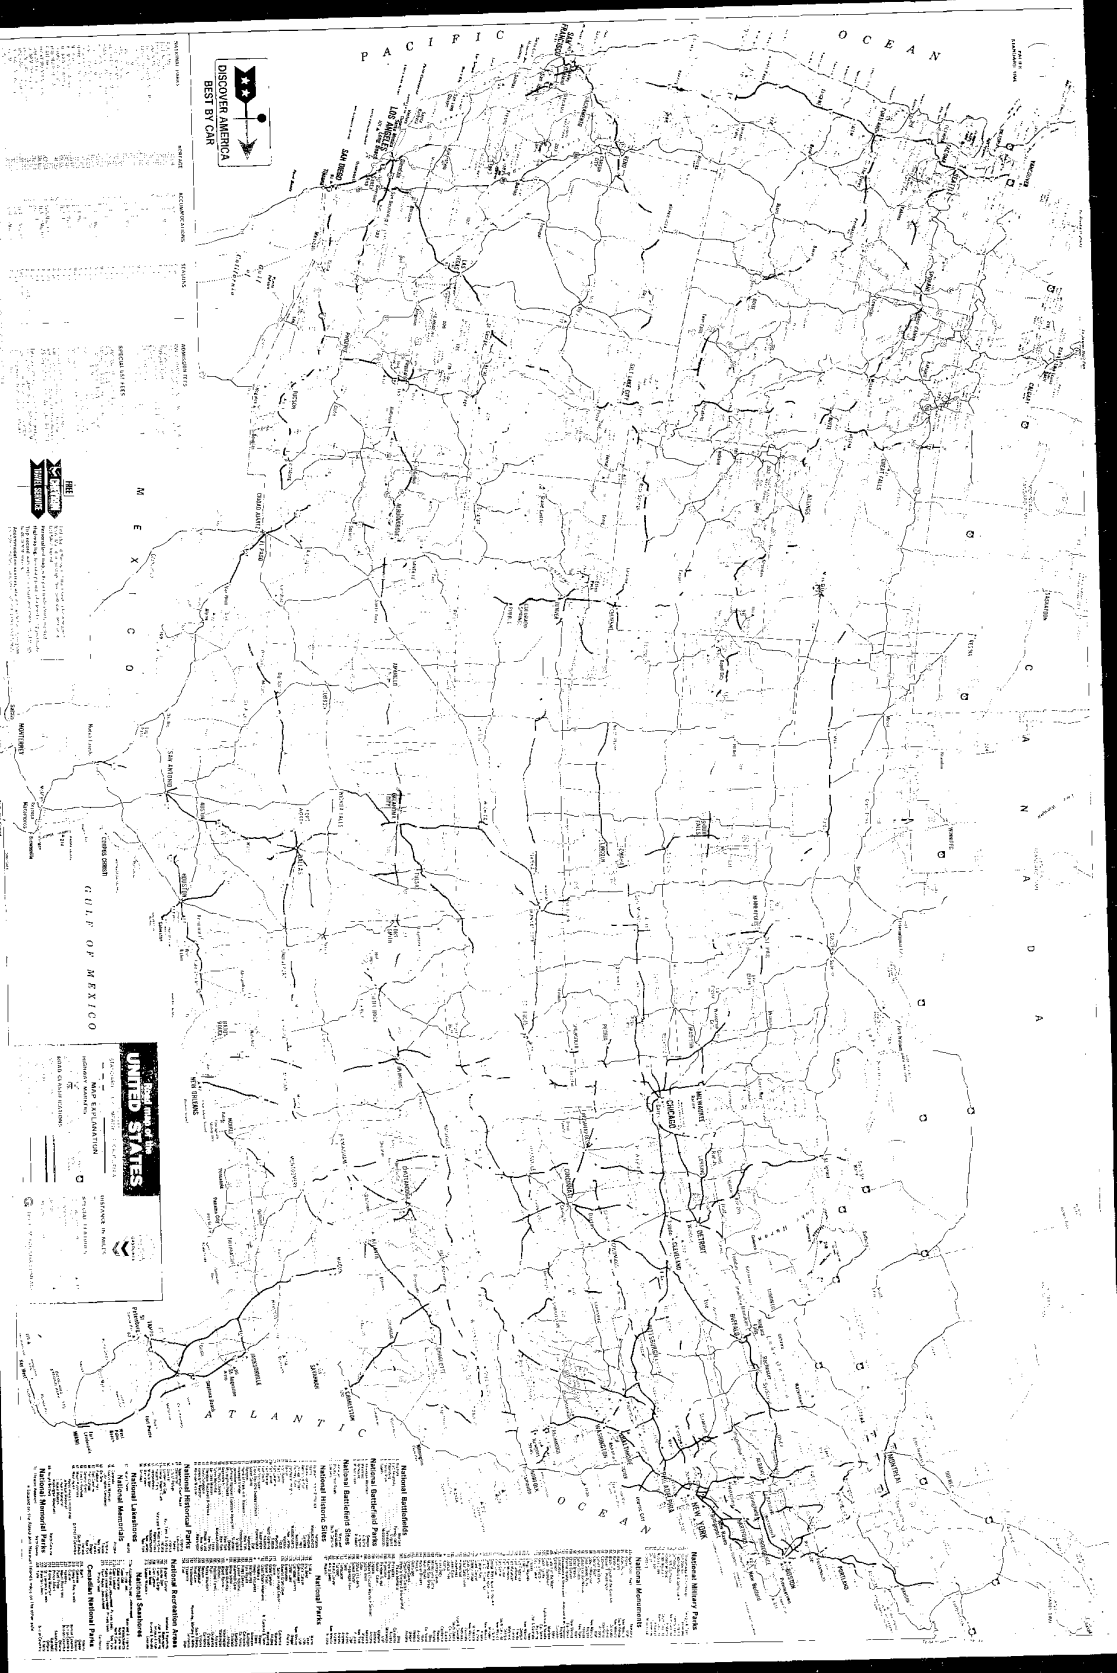



UNITED STATES



Shouldn't you be holding the most convenient, most widely used credit card in the West?



This card will let you charge **more** things,
at **more** stations, throughout the West, than
any other credit card.

It establishes instant credit for your driving, boating and flying needs. Instant acceptance in all fifty states and Canada. And budget terms for large purchases.

Over 4 million are already in the hands of Westerners. Do **you** have one? If not, we'd like to offer **you** the convenience of the West's No. 1 credit card. Why not ask about it at the sign of the Chevron?

The Chevron
ABOVE ALL
means service

CHEVRON DEALERS • STANDARD STATIONS

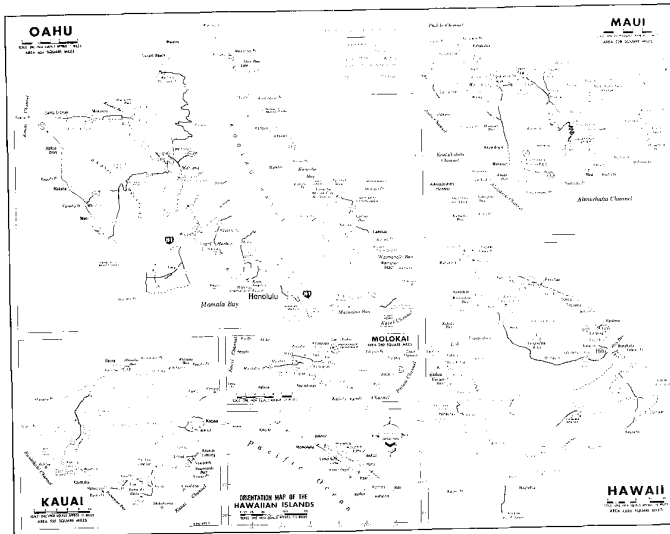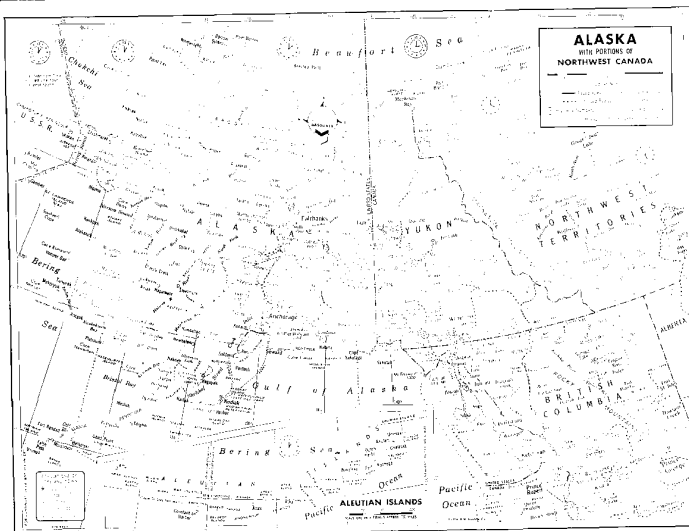

TRANS²⁰¹⁴CONTINENTAL MILEAGE CHART

TRANSOM

1/2" = 1'-0"

1/4" = 1'-0"

1/8" = 1'-0"

1/16" = 1'-0"

1/32" = 1'-0"

1/64" = 1'-0"

1/128" = 1'-0"

1/256" = 1'-0"

1/512" = 1'-0"

1/1024" = 1'-0"

1/2048" = 1'-0"

1/4096" = 1'-0"

1/8192" = 1'-0"

1/16384" = 1'-0"

1/32768" = 1'-0"

1/65536" = 1'-0"

1/131072" = 1'-0"

1/262144" = 1'-0"

1/524288" = 1'-0"

1/1048576" = 1'-0"

1/2097152" = 1'-0"

1/4194304" = 1'-0"

1/8388608" = 1'-0"

1/16777216" = 1'-0"

1/33554432" = 1'-0"

1/67108864" = 1'-0"

1/134217728" = 1'-0"

1/268435456" = 1'-0"

1/536870912" = 1'-0"

1/1073741824" = 1'-0"

1/2147483648" = 1'-0"

1/4294967296" = 1'-0"

1/8589934592" = 1'-0"

1/17179869184" = 1'-0"

1/34359738368" = 1'-0"

1/68719476736" = 1'-0"

1/137438953472" = 1'-0"

1/274877906944" = 1'-0"

1/549755813888" = 1'-0"

1/1099511627776" = 1'-0"

1/2199023255552" = 1'-0"

1/4398046511104" = 1'-0"

1/8796093022208" = 1'-0"

1/17592186044416" = 1'-0"

1/35184372088832" = 1'-0"

1/70368744177664" = 1'-0"

1/140737488355328" = 1'-0"

1/281474976710656" = 1'-0"

1/562949953421312" = 1'-0"

1/1125899906842624" = 1'-0"

1/2251799813685248" = 1'-0"

1/4503599627370496" = 1'-0"

1/9007199254740992" = 1'-0"

1/18014398509481984" = 1'-0"

1/36028797018963968" = 1'-0"

1/72057594037927936" = 1'-0"

1/144115188075855872" = 1'-0"

1/288230376151711744" = 1'-0"

1/576460752303423488" = 1'-0"

1/1152921504606846976" = 1'-0"

1/2305843009213693952" = 1'-0"

1/4611686018427387904" = 1'-0"

1/9223372036854775808" = 1'-0"

1/18446744073709551616" = 1'-0"

1/36893488147419103232" = 1'-0"

1/73786976294838206464" = 1'-0"

1/147573952589676412928" = 1'-0"

1/295147905179352825856" = 1'-0"

1/590295810358705651712" = 1'-0"

1/1180591620717411303424" = 1'-0"

1/2361183241434822606848" = 1'-0"

1/4722366482869645213696" = 1'-0"

1/9444732965739290427392" = 1'-0"

1/18889465931478580854784" = 1'-0"

1/37778931862957161709568" = 1'-0"

1/75557863725914323419136" = 1'-0"

1/151115727451828646838272" = 1'-0"

1/302231454903657293676544" = 1'-0"

1/604462909807314587353088" = 1'-0"

1/1208925819614629174706176" = 1'-0"

1/2417851639229258349412352" = 1'-0"

1/4835703278458516698824704" = 1'-0"

1/9671406556917033397649408" = 1'-0"

1/19342813113834066795298816" = 1'-0"

1/38685626227668133590597632" = 1'-0"

1/77371252455336267181195264" = 1'-0"

1/154742504910672534362390528" = 1'-0"

1/309485009821345068724781056" = 1'-0"

1/618970019642690137449562112" = 1'-0"

1/1237940039285380274899124224" = 1'-0"

1/2475880078570760549798248448" = 1'-0"

1/4951760157141521099596496896" = 1'-0"

1/9903520314283042199192993792" = 1'-0"

1/19807040628566084398385987584" = 1'-0"

1/39614081257132168796771975168" = 1'-0"

1/79228162514264337593543950336" = 1'-0"

1/158456325028528675187087900672" = 1'-0"

1/316912650057057350374175801344" = 1'-0"

1/633825300114114700748351602688" = 1'-0"

1/1267650600228229401496703205376" = 1'-0"

1/2535301200456458802993406410752" = 1'-0"

1/5070602400912917605986812821504" = 1'-0"

1/10141204801825835211973625643008" = 1'-0"

1/20282409603651670423947251286016" = 1'-0"

1/40564819207303340847894502572032" = 1'-0"

1/81129638414606681695789005144064" = 1'-0"

1/162259276829213363391578010288128" = 1'-0"

1/324518553658426726783156020576256" = 1'-0"

1/649037107316853453566312041152512" = 1'-0"

1/1298074214633706907132624082305024" = 1'-0"

1/2596148429267413814265248164610048" = 1'-0"

1/5192296858534827628530496329220096" = 1'-0"

1/10384593717069655257060992658440192" = 1'-0"

1/20769187434139310514121985316880384" = 1'-0"

1/41538374868278621028243970633760768" = 1'-0"

1/83076749736557242056487941267521536" = 1'-0"

1/166153499473114484112975882535043072" = 1'-0"

1/332306998946228968225951765070086144" = 1'-0"

1/664613997892457936451903530140172288" = 1'-0"



1/1329227995784915872903807060280344576" = 1'-0"


1/2658455991569831745807614120560689152" = 1'-0"

1/5316911983139

FBI


LABORATORY
1955

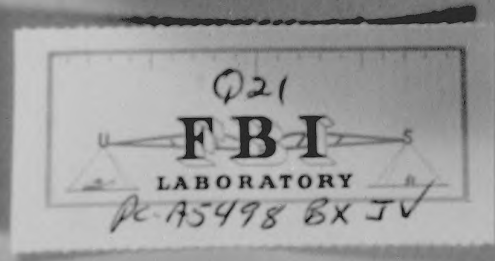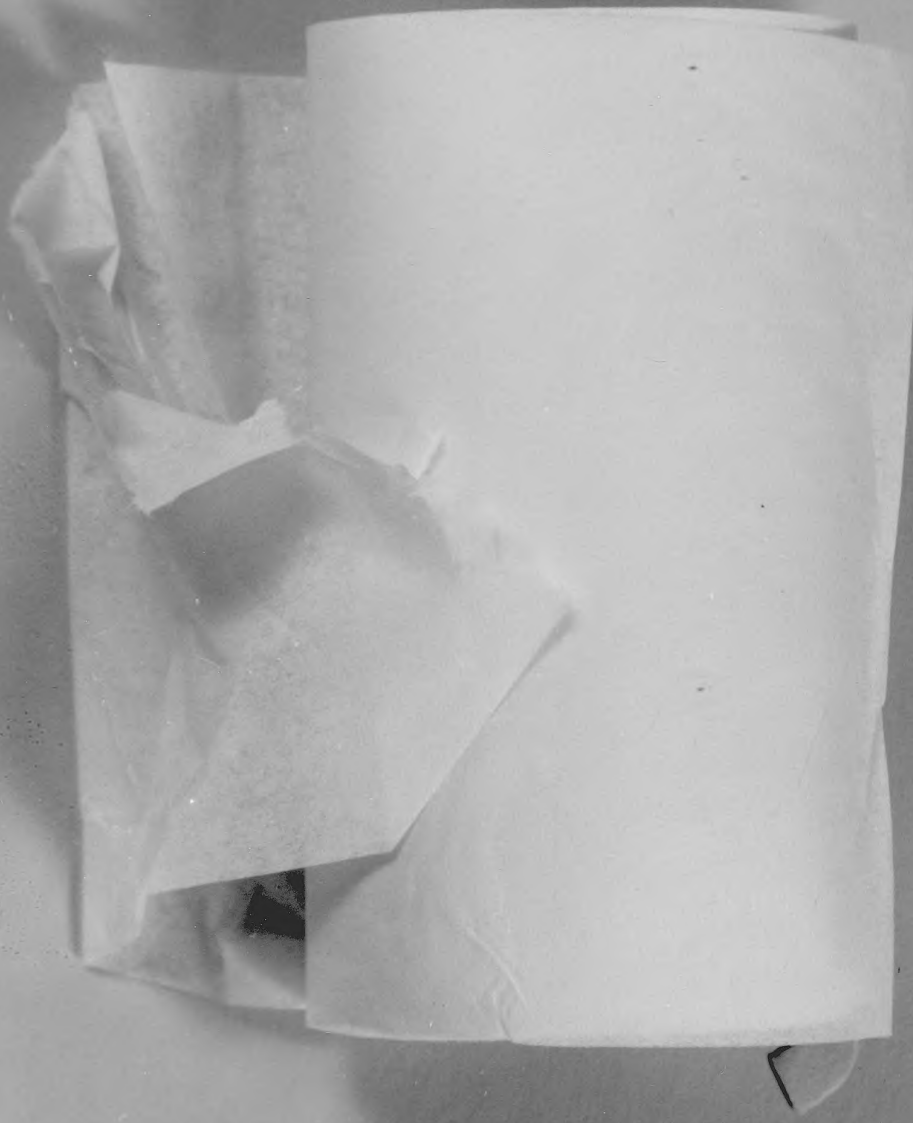

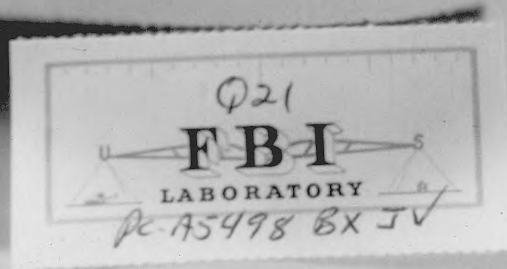




2025 RELEASE UNDER E.O. 14176

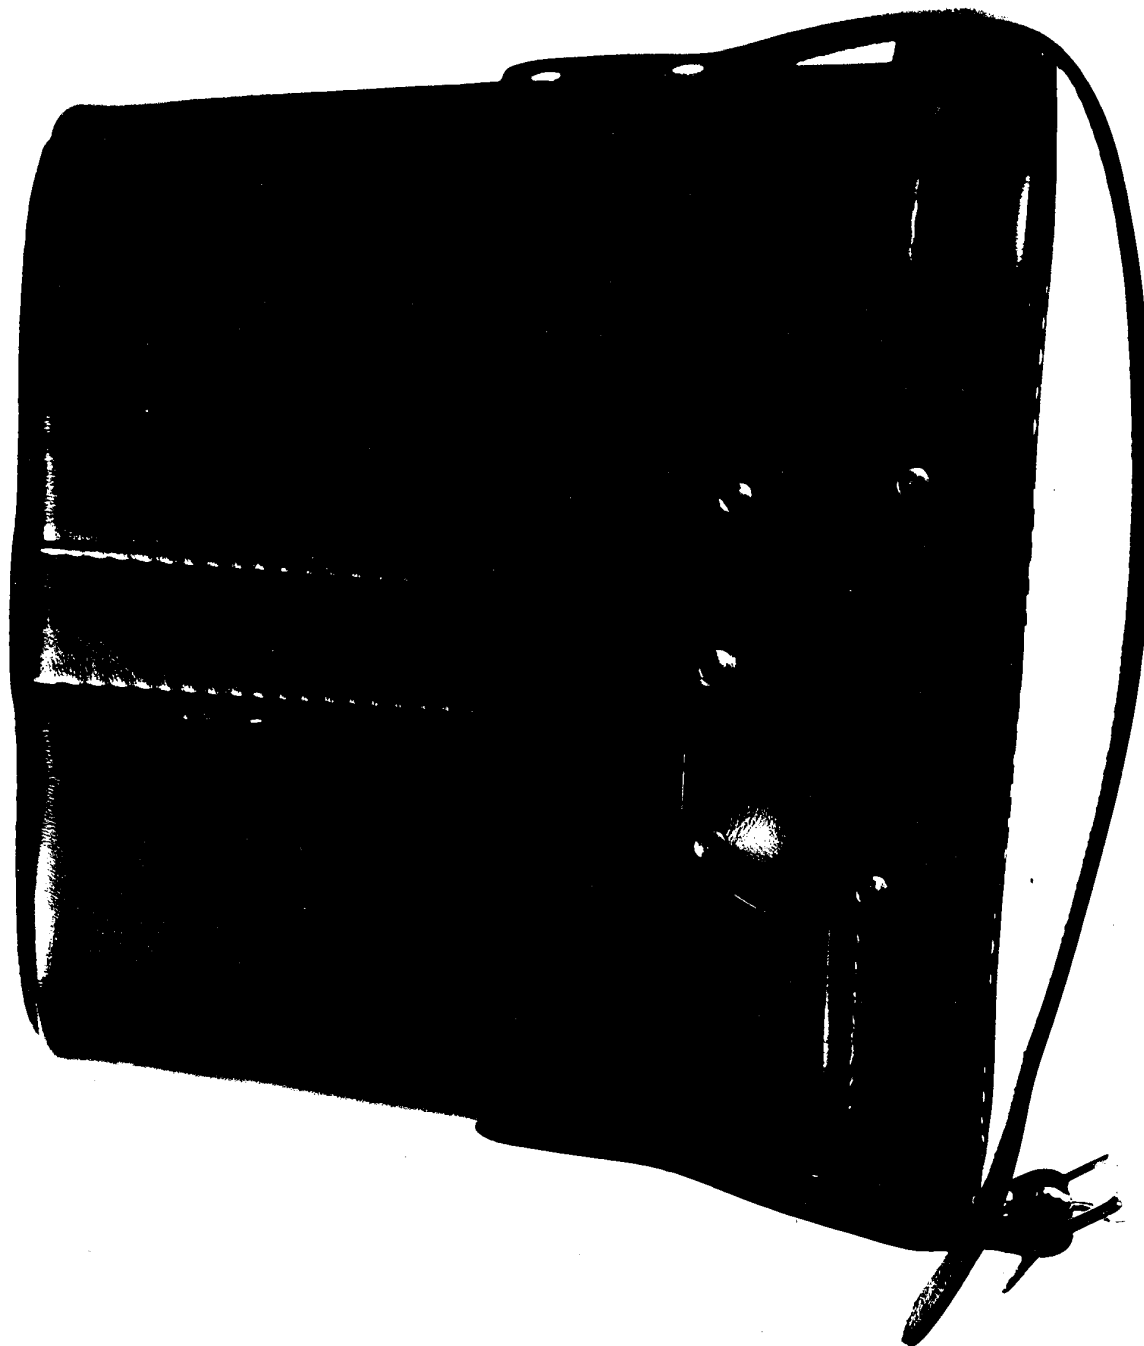

2025 RELEASE UNDER E.O. 14176

Q22

most distinguished name in sight

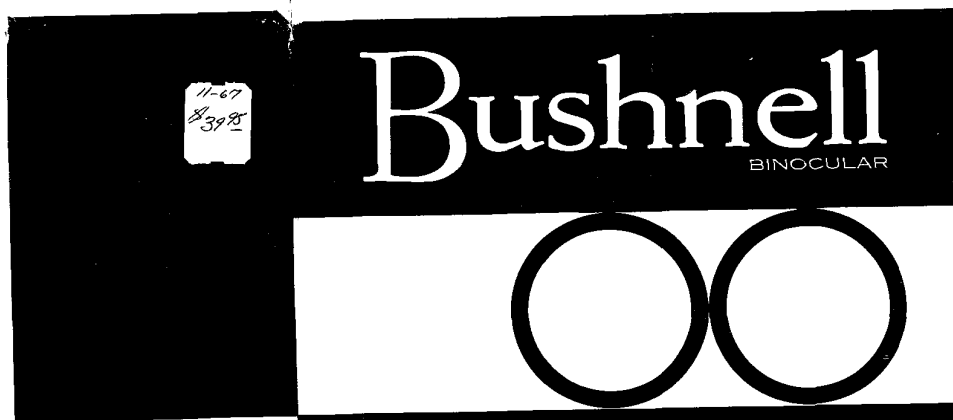

Bushnell
BINOCULAR

#12-7350
7x35 CF Banner

most distinguished name in sight



6582

3


BROWNING

SHOTGUNS RIFLES PISTOLS

Mausser Rifle

BROWNING

1871

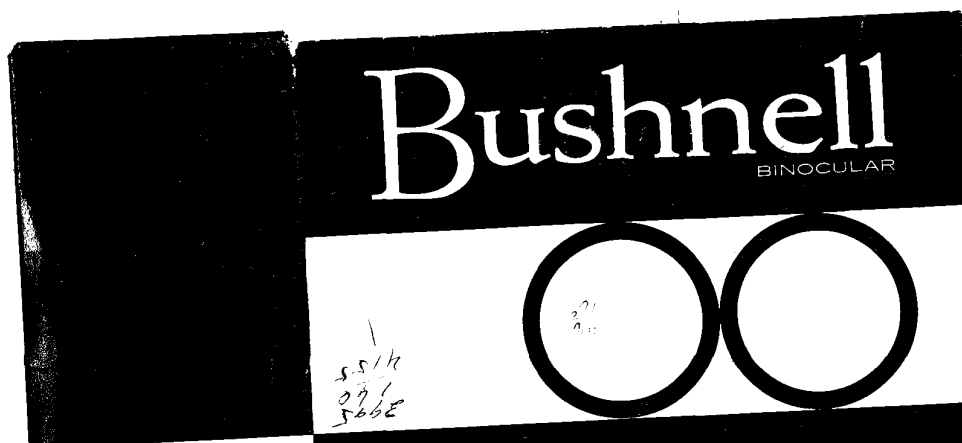

Bushnell
BINOCULAR

most distinguished name in sight


1263

most distinguished name in sight


Printed in U.S.A.




2025

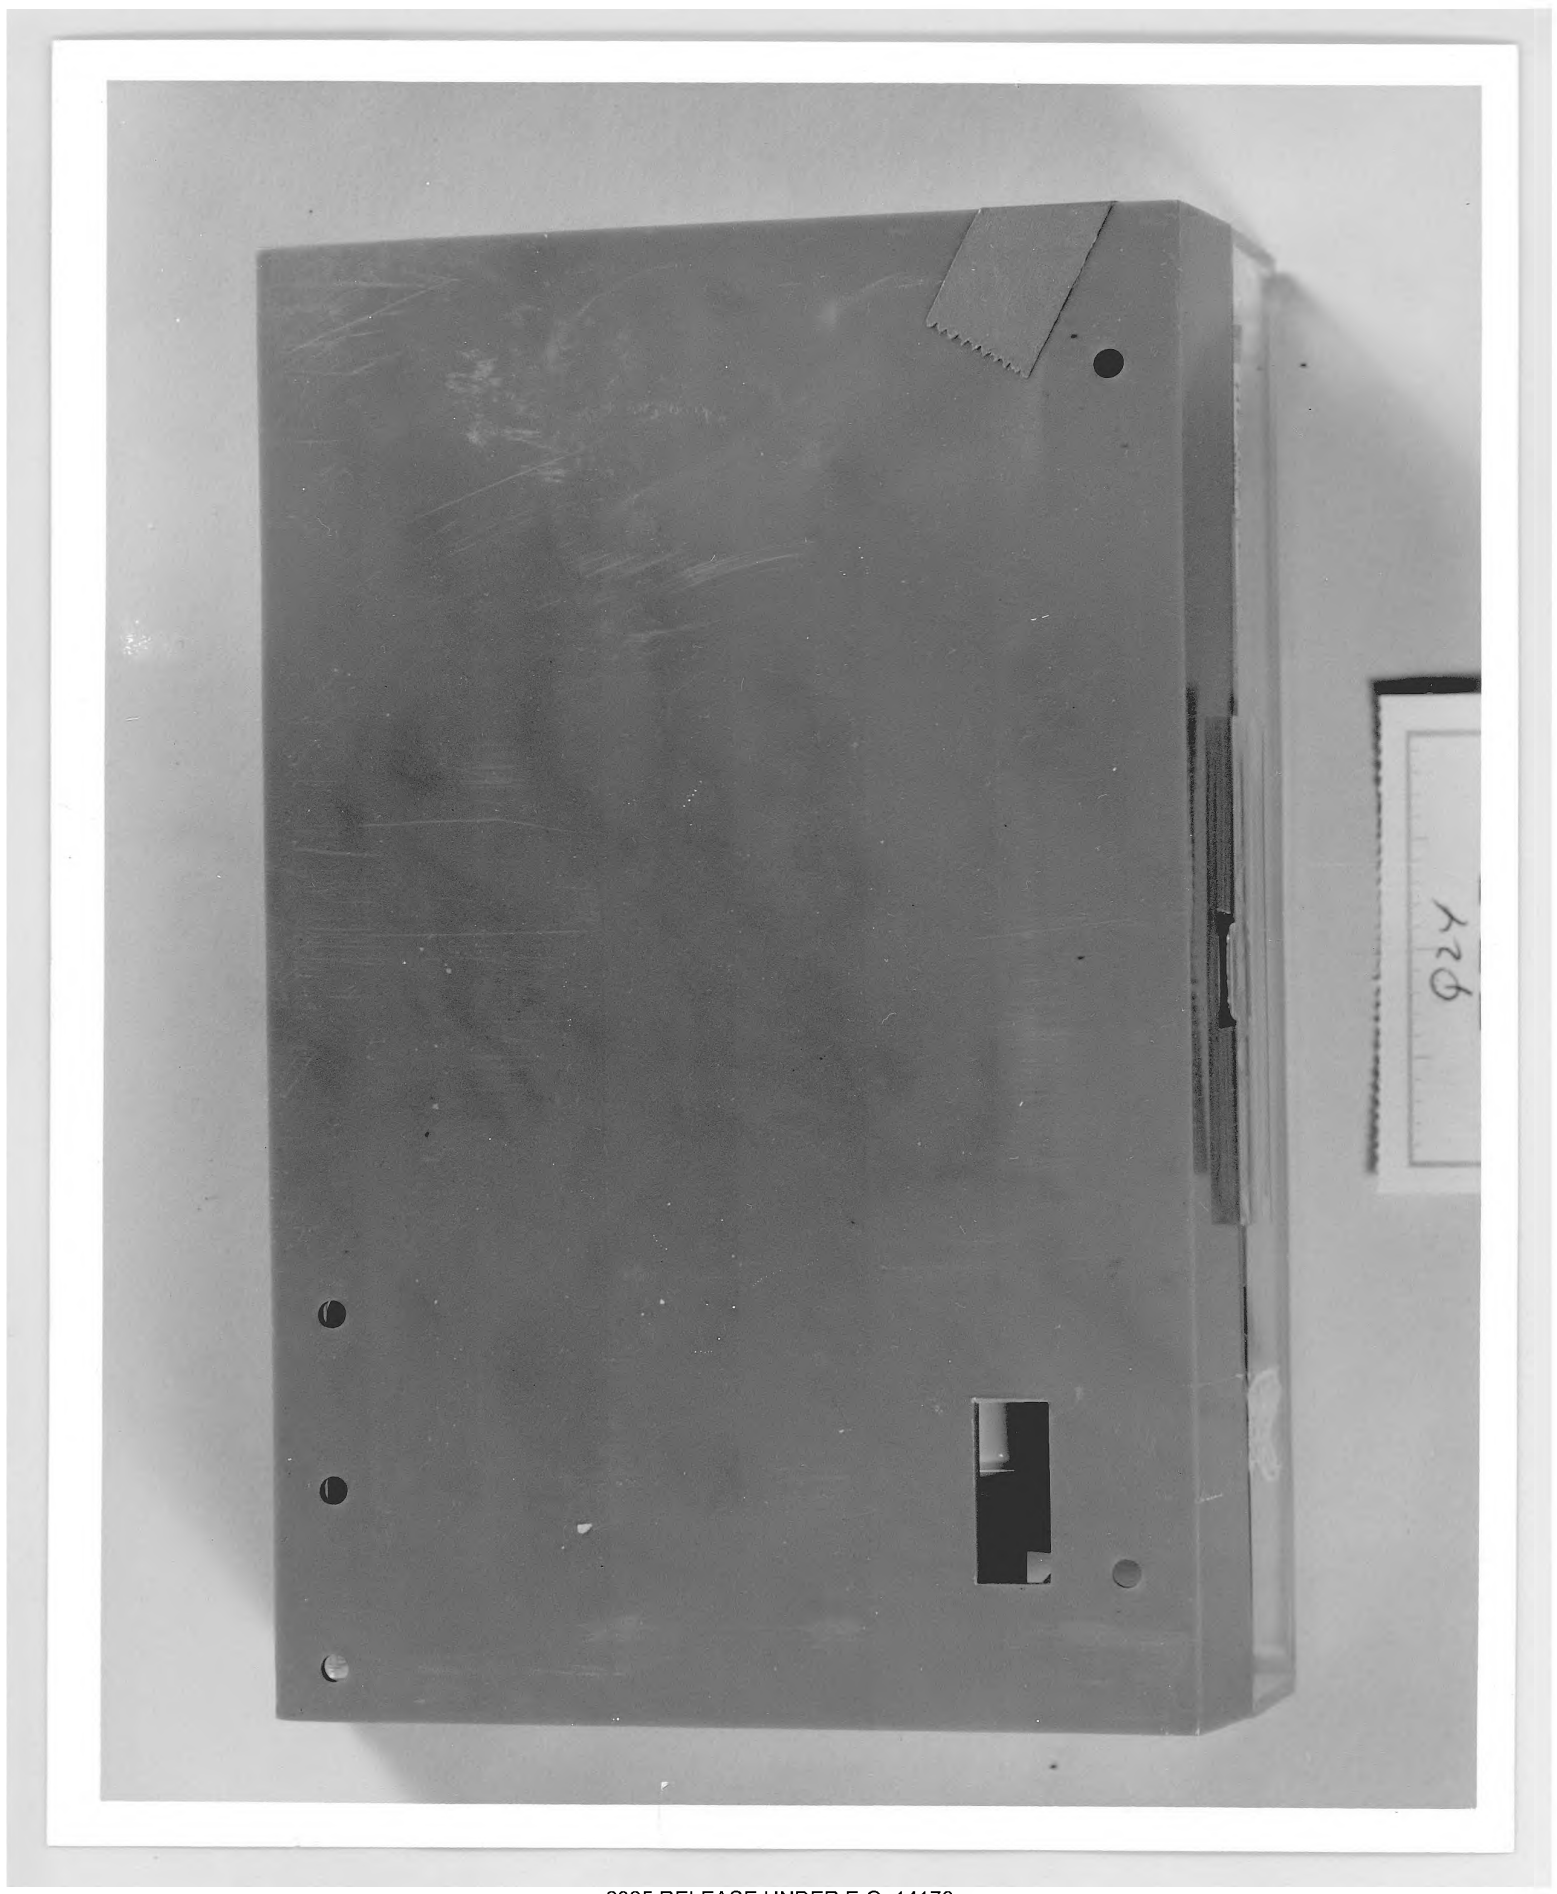

2025 RELEASE UNDER E.O. 14176

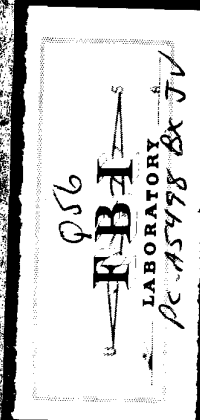

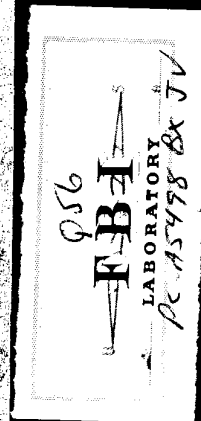




Q37


FBI

LABORATORY

PC 15775 BX JV

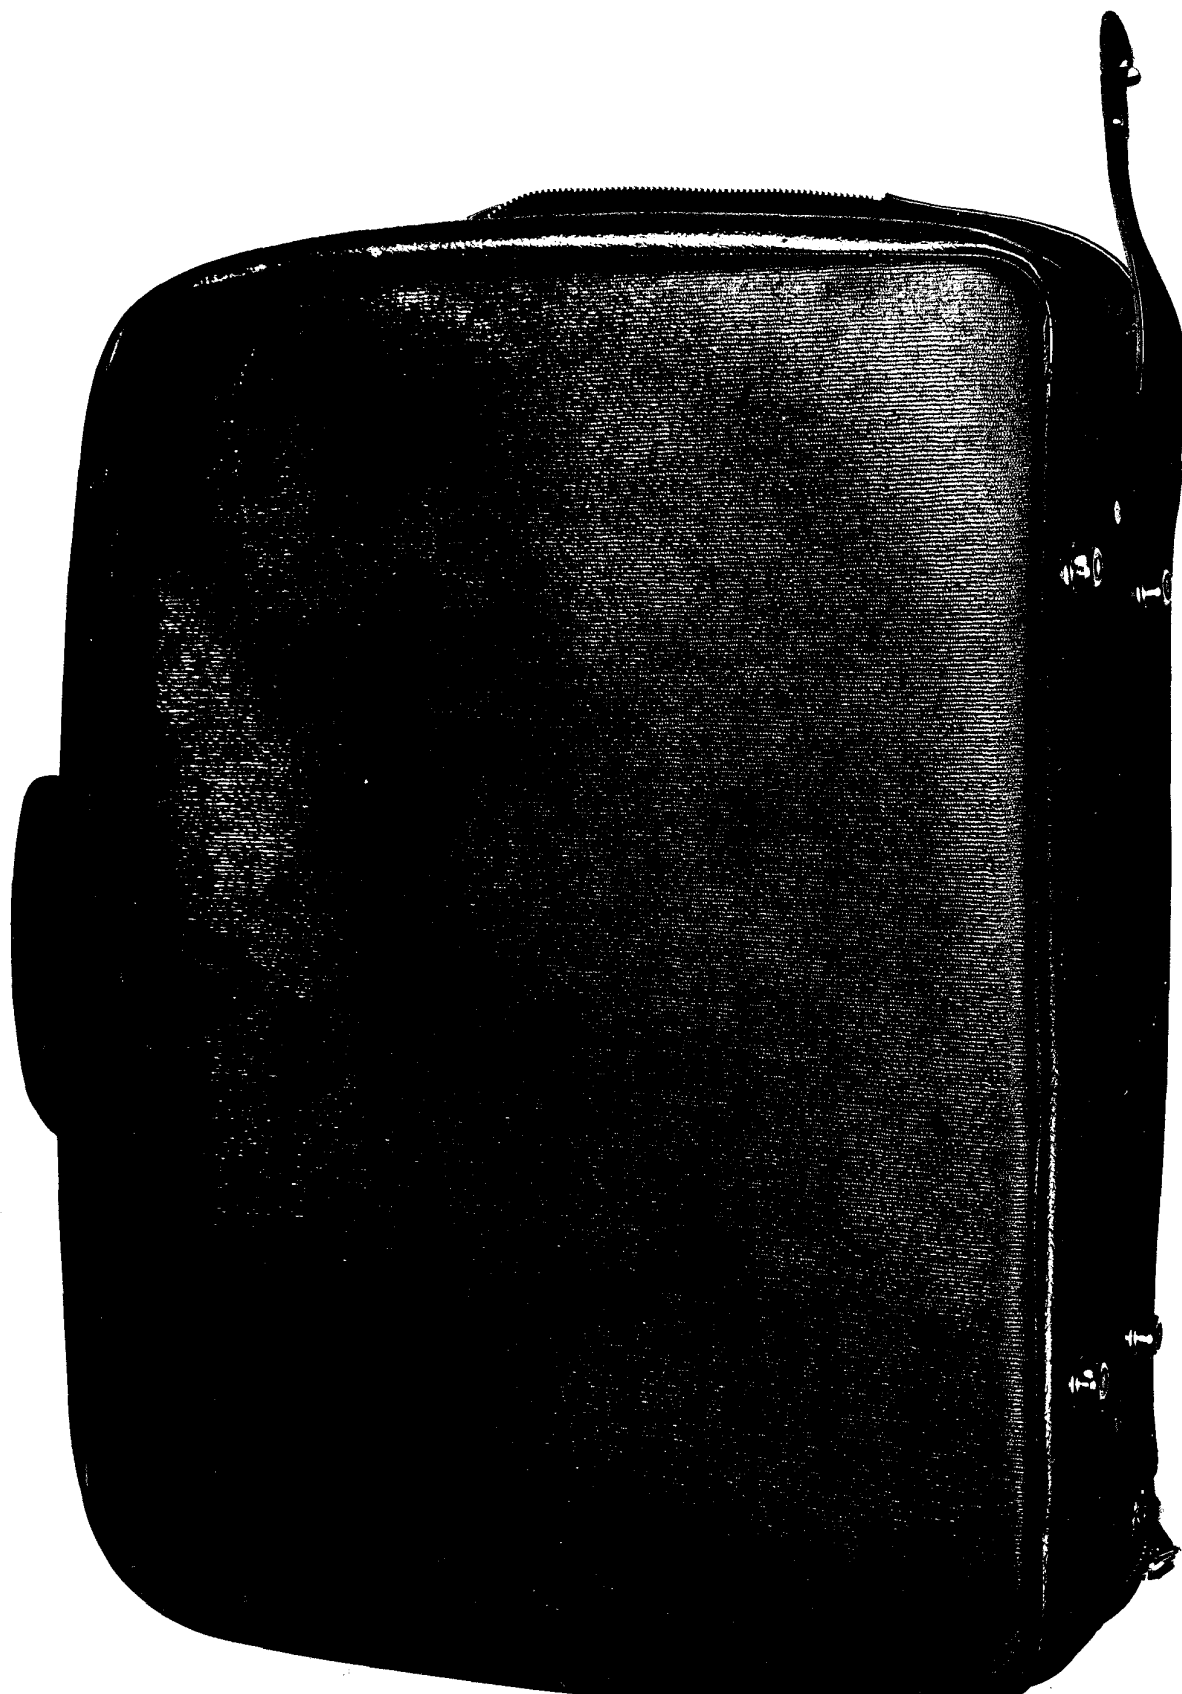

2025 RELEASE UNDER E.O. 14176

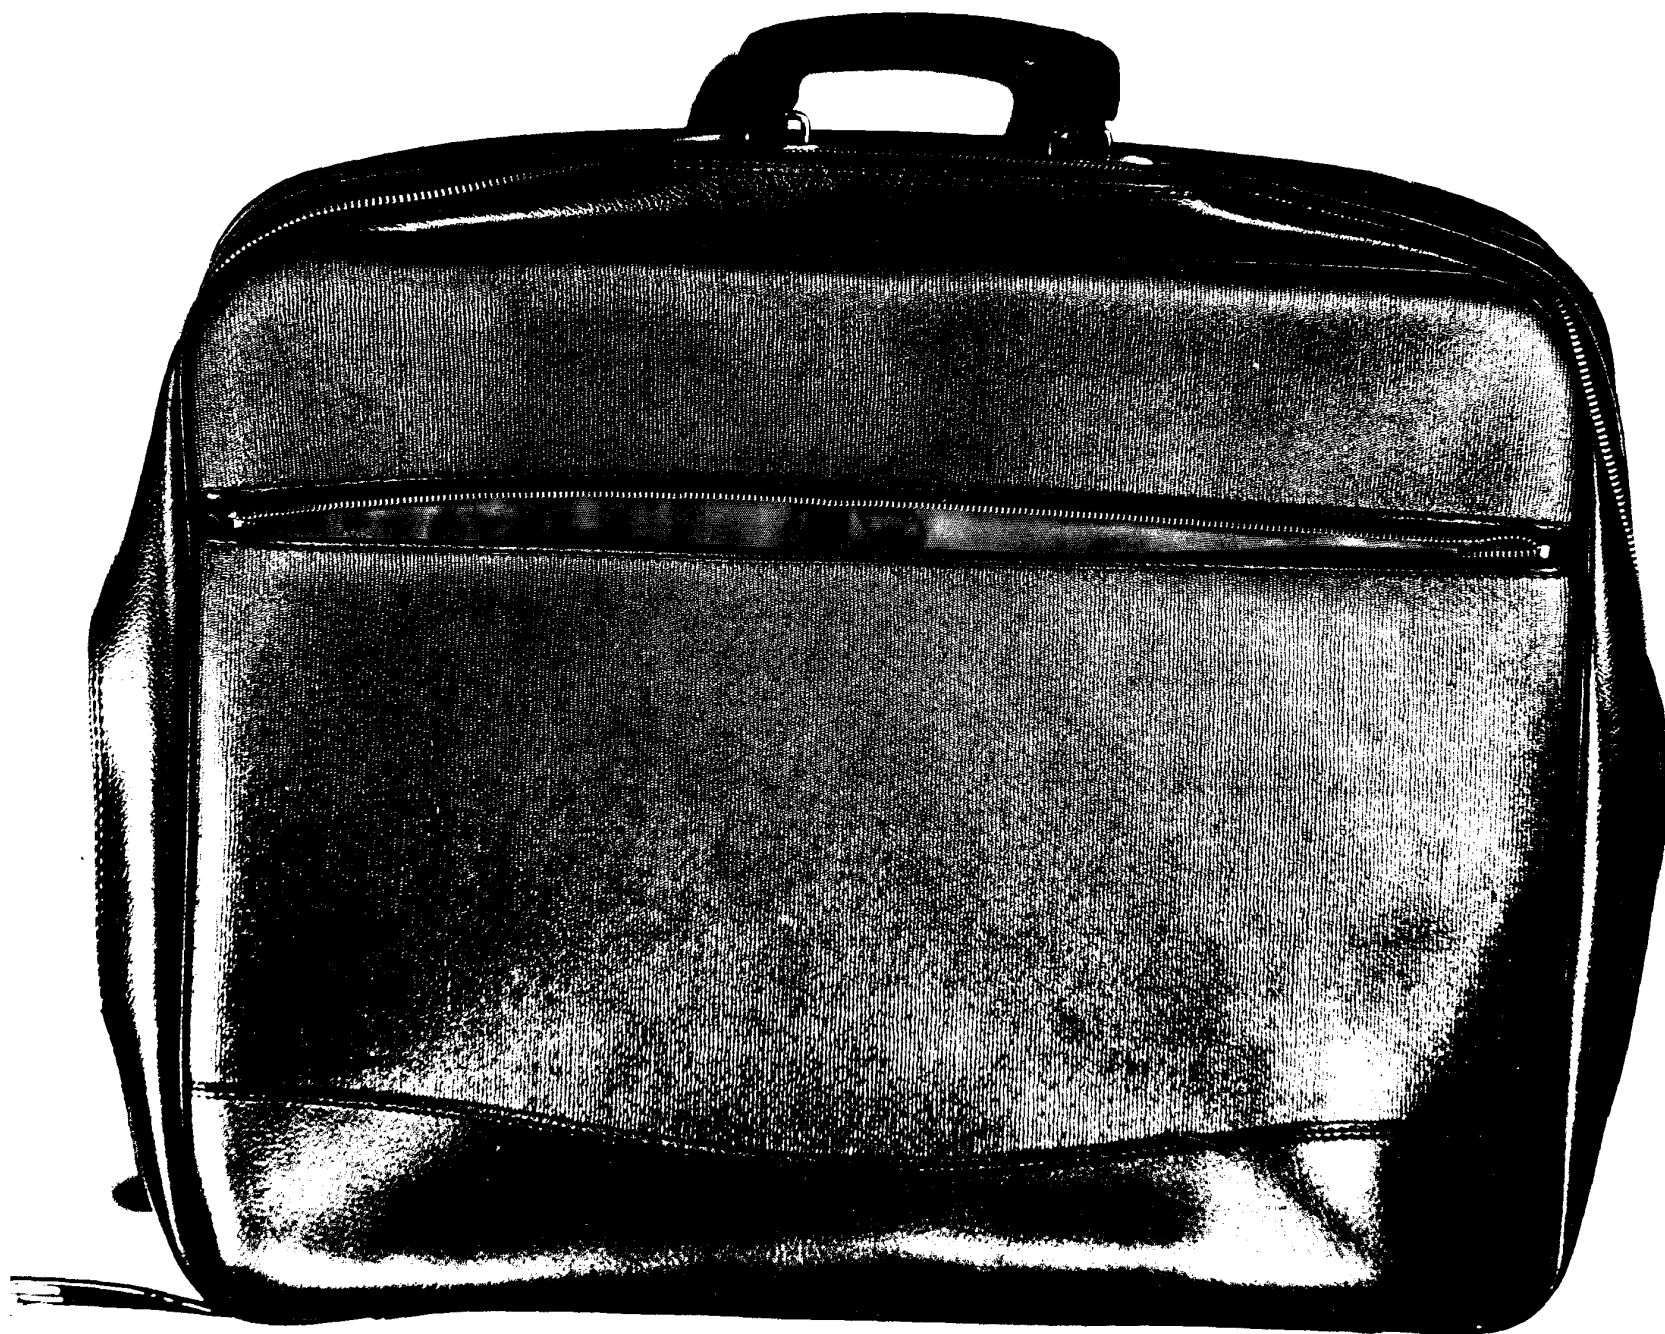

2025 RELEASE UNDER E.O. 14176


Q15





Q10
FBI
LABORATORY



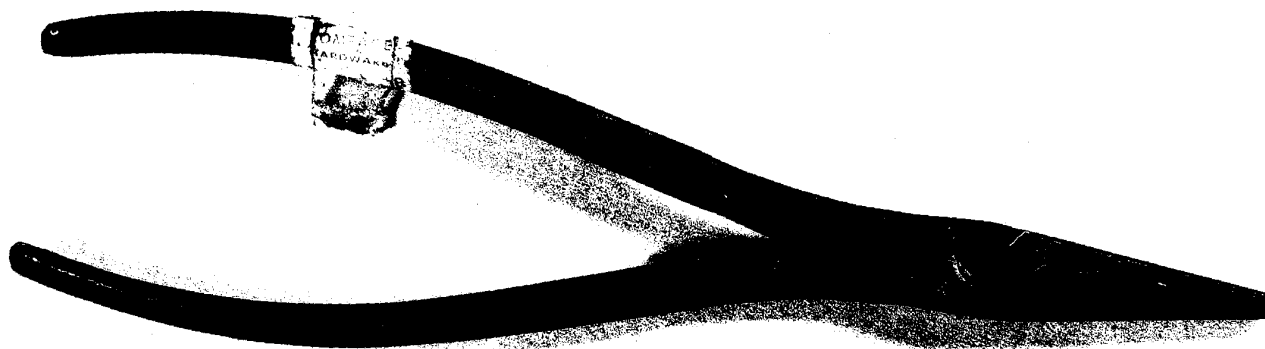

Q16
FBI
LABORATORY

sheer strips



sheer
strips

Johnson & Johnson

Q17

FBI

LABORATORY

LABORATORY

FBI

Q17

31 ADHESIVE BANDAGES

21-3/4" STRIPS • 10 JUNIORS

BAND-AID
BRAND
**sheer
strips**



**NEW OVERALL AIR-VENTS
for faster healing**

Air-vents over the gauze pad—speed healing. Air-vents on the tape part keep the skin fresh. More comfortable to wear—with SUPER-STICK. For best results, be sure skin is clean and dry before applying bandage. Good medical practice suggests changing bandage if pad becomes wet.

Johnson & Johnson

NEW BRUNSWICK, NEW JERSEY • MADE IN U.S.A. • CJAJ

CODE 4614